
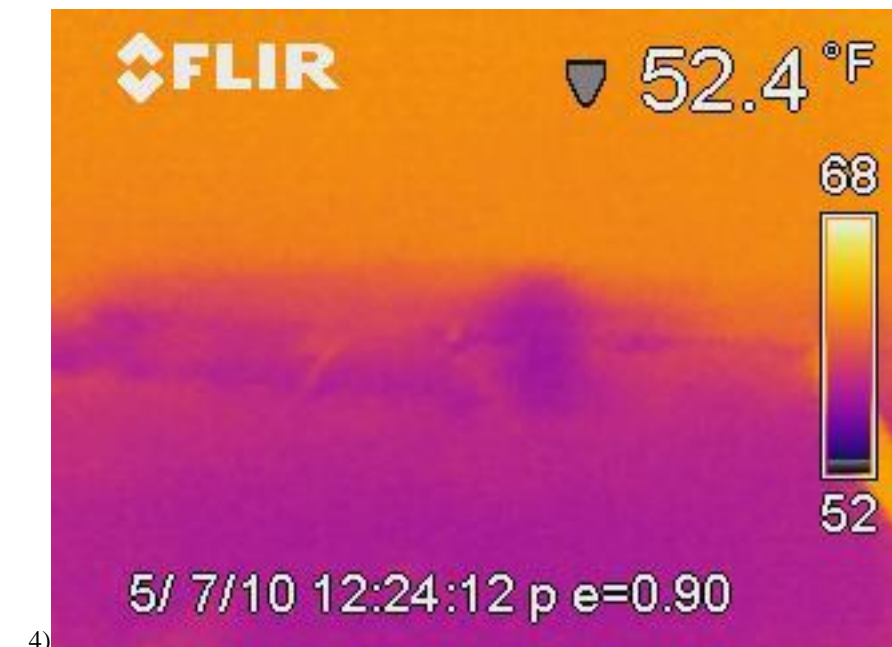
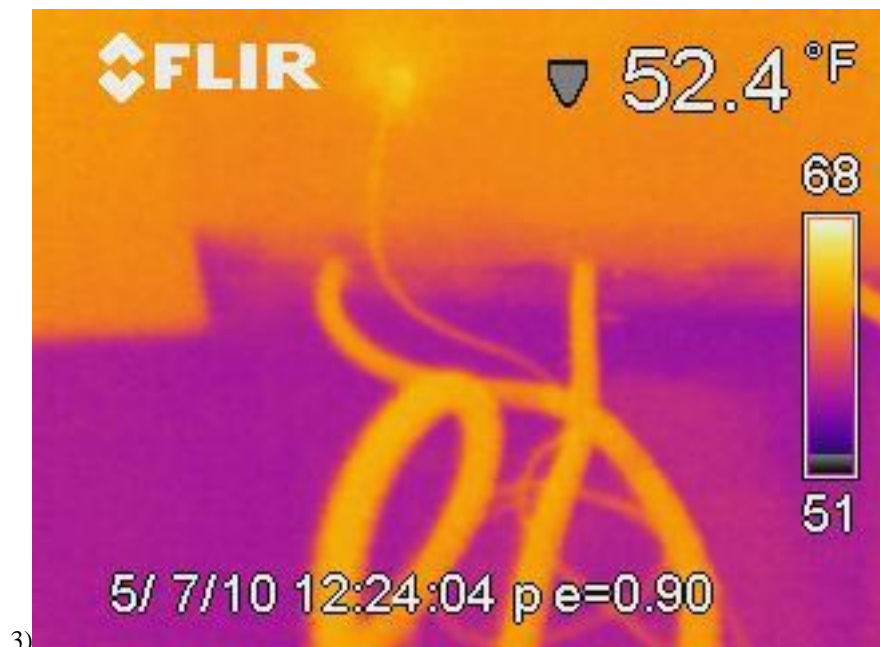
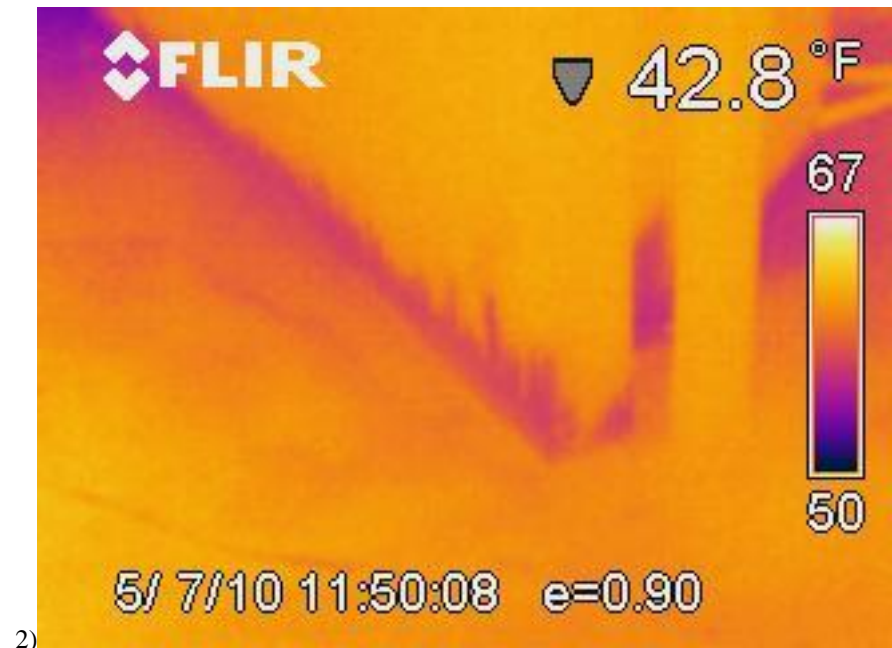



**ADVOCATE INSURANCE RESTORATION & ENERGY CONSULTANTS, LLC**

**(401)474 -6014 energyAIRpro.com apetest@cox.net RI CONSTRUCTION LICENSE #28287**

Owner : XXX XXXXXXXXX, XXXXX XXXX Road, North Smithfield, RI 02896

Inspected: 5/7/2010

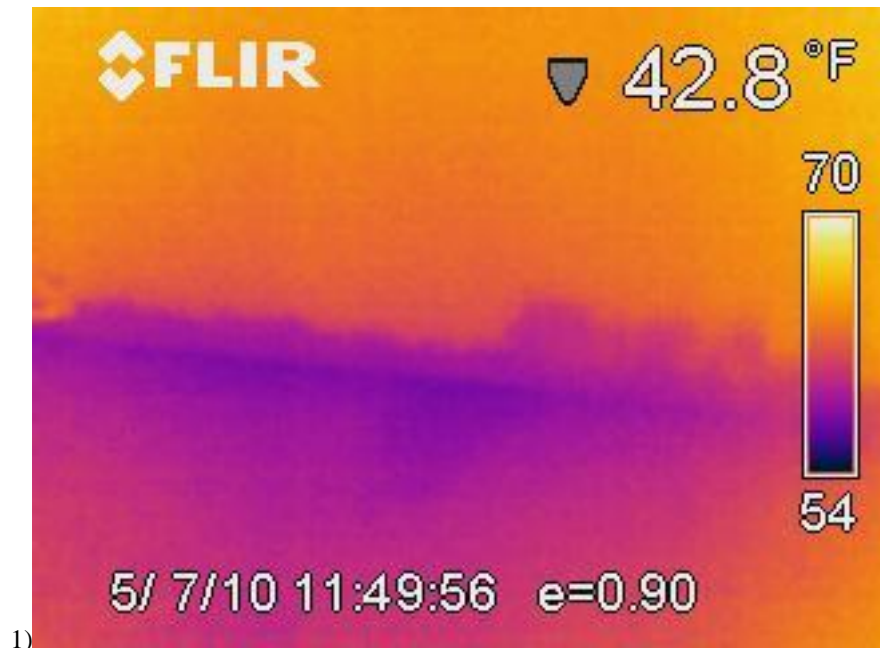

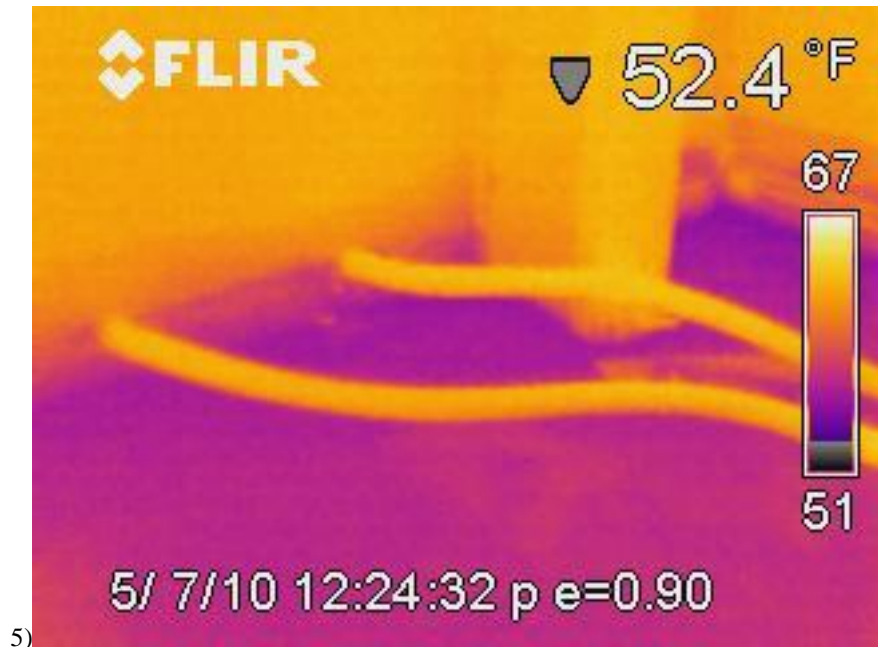

### COMMENTS

Advocate removed 80-100 gallons of water due to hot water tank bladder breach in the basement of XX XXXX Hill Road, North Smithfield.

Some drywall in the bedroom will need to be replaced, but T1-11 can be saved because we used Injecti-dry equipment but it will need to be painted with an antimicrobial primer. Some waferboard wall in the utility room can also be saved because of how quickly we responded, but it will also need to be coated with antimicrobial primer.

Todd Pascoe CIE/CIRBST/BPI Certified Building Analyst  
Certified Infrared Building Science Thermographer  
IICRC #131388 WRT & FRT Designation